KNYEE ENERGY
SP. Z O.O.

Knyee Energy Sp. z o.o.
Address: Nowopolna 11, 67-400 Wschowa, Poland
Email: info@knyee-energy.com, wayne@knyee-energy.com
Web: www.knyee-energy.com

KNYEE ENERGY
SP. Z O.O.

Installation and Operation Manual



ES-LV-16 PLUS

INSTALLATION AND OPERATION MANUAL

PLEASE READ THIS MANUAL BEFORE USE

1. Introduction 1
1.1 Statement 1
1.2 Implications of Abbreviations 1
2. Safety Instructions 1
2.1 Important Reminder 1
2.2 Requirements for Specification 2
2.3 Personnel Safety 3
2.4 Personnel Requirements 4
2.5 Electrical Safety 4
2.5.1 Earthing Requirements 5
2.5.2 Installation Environment Requirements 5
2.5.3 Installation Notes 6
2.6 Warning Label 7
3. Product Introduction 7
3.1 Product Overview and Features 7
3.2 Appearance Description 8
3.2.1 Appearance Introduction 9
3.2.2 Port Function Description 9
3.3 Working Principle and Function 10
4. Installation Matters 10
4.1 Check before Installation 10
4.2 Tool and Labor Insurance 10
4.3 Selection of Installation Location 11
4.3.1 Basic Requirements 11
4.3.2 Requirements for the Installation Space 11
4.4 Equipment Installation 12
5. Electrical Connection 12
5.1 Battery Module Address Setting 14
5.2 LED Indication Function 14

5.2.1 Capacity Indicator 15
5.2.2 LED Flashing Instructions 16
5.3 Communication Function 16
5.3.1 RS485 Communication 16
5.4 Battery Status Mode 17
6. Electrical Specification and BMS 18
6.1 Electrical Specification 18
6.2 BMS 19
6.2.1 BMS System Schematic Diagram 19
6.2.2 BMS Parameter 19
6.2.3 BMS LCD display screen 20
7. Equipment Acceptance 26
7.1 Acceptance Standard 26
8. Routine Maintenance and Storage of Batteries 27
8.1 Battery System Maintenance 27
8.2 Routine Maintenance 27
8.3 Battery Storage 28
8.4 Battery Module Data 29
Maintenance Record 31

1. Introduction

1.1 Statement

Thanks a lotfor choosing Floor-standing type ES-LV-16 PLUS series energy storage system. This manual will provide detailed productinformation and installation instructions for users who use this Floor-standing type ES-LV-16 PLUS series energy storage system. Please read all instructions and precautions in the manual carefully before installation and use. If you have any suggestions during use, please feel free to give us feedback.We will not notify users of any modification to this manual.

The drawings provided in this manual are used to explain product-related concepts, including productinformation , installation guidelines, electrical connections, system commissioning, safety information, common problems and maintenance, etc.

1.2 Implications of Abbreviations

AC	Alternating Current
DC	Direct Current
PV	Photovoltaic
BMS	Battery Management System
PCS	Power Conversion System
RJ45	RJ45 Modular Plug
SOC	State of Charge
C	Current-Rate
RS485	Recommended Standard 485
CAN	Controller Area Network

2. Safety Instructions

2.1 Important Reminder

Before installing, operating and maintaining the equipment, please read this manual first, and follow the symbols on the equipment and all safety precautions in

this manual. For safety, itis the installer's responsibility to familiarize himself with this manual and all warnings prior to installation.

Items marked with "danger" and "attention" in this manual do not represent all safety items to be observed, but are only supplements to all safety precautions. We are not responsible for any violation of general safety operation requirements, or Any operation that violates equipment design, production and use safety standards. The device must be used in an environmentthat meets the requirements ofthe design specification. Otherwise, the equipment may malfunction, and the resulting abnormal equipmentfunction or component damage, personal safety accidents and property losses are not within the scope of equipment quality assurance. Local laws, regulations and norms should be followed while installing, operating and maintaining equipment. The safety precautions in this manual are only a supplementto local laws, regulations and norms. In any ofthe following circumstances, We shall not be liable:

1) The equipmentis not performed under the operating conditions described in this manual;
2) The installation and operation environment exceeds the requirements ofthe relevantinternational or national standards;
3) Disassemble, modify or modify the software code ofthe products without authorization;
4) Failure to comply with the operating instructions and safety warnings related to the product and documents;
5) Equipment damage caused by abnormal natural environment (earthquake, fire, storm and other force majeure);
6) The transportation damage caused by the customer during the transportation;
7) The storage conditions do not meetthe requirements of relevant product documents and cause damage;
8) Failure to observe the safety precautions and rules in this operating instruction and document.

2.2 Requirements for Specification

1) Live operation is forbidden during the installation;
2) Itis strictly forbidden to install, use and operate any outdoor equipment and cables in harsh environments(including but not limited to transportation equipment, operating equipment and cables, plugging and removing signal ports

connected to the outdoor, working at heights, outdoor installation). Thunder, rain, snow, strong wind and other six-level weather;

3) In any case, withoutthe permission ofthe manufacturer, the structure and installation sequence ofthe equipment shall not be changed;
4) The battery terminal assembly shall not be affected during transportation;
5) Itis strictly forbidden to alter, damage or cover the signs and nameplates on the equipment;
6) Fully understand the composition and working principle ofthe entire photovoltaic power generation system, as well as the relevant standards ofthe country/region where the projectis located;
7) After the equipmentis installed, the empty packaging materials in the equipment area should be removed, such as cartons, foam, plastic, cable ties, etc.

2.3 Personnel Safety

1) Wear appropriate personal protective equipment when operating equipment. If a failure that may cause personal injury or equipment damage is found, the operation should be stopped immediately;
2) Before using any tools, please understand the correct use oftools to avoid injury and equipment damage;
3) When the equipmentis running, the shell temperature is high, which may cause burns. Therefore, do nottouch the case;
4) In order to ensure personal safety and normal use, reliable grounding should be conducted before use;
5) Do not open or damage the battery, the released electrolyte is harmful to the skin and eyes, so avoid touching it;
6) Do not place unrelated items on the top ofthe equipment or insertthem into any part ofthe equipment;
7) Do not place flammable items around the equipment;
8) Do not putthe battery into fire, so as notto explode and prevent personal safety from being endangered;
9) Do not place the battery module in water or other liquids;
10) Do not short-circuitthe battery termina l, otherwise the battery short-circuit may cause an explosion;

11) The battery may cause the danger of electric shock and large short-circuit currents. Some matters should be noted when using the battery:
    a) Watches, rings and other metal items should be removed;
    b) Tools with insulated handles shall be used;
    c) Rubber gloves and shoes shall be worn;
    d) Disconnectthe charging power supply before connecting or disconnecting the battery terminal;
    e) Check the battery for accidental grounding, and if so, unplug the power supply from the ground wire.
12) Do not clean the internal and external electrical components ofthe cabinet with water or detergent;
13) Do not stand, lean, or sit on the equipment;
14) Do not damage any modules ofthe equipment.

2.4 Personnel Requirements

1) The personnel responsible for installation and maintenance must undergo strict training, understand all safety precautions and master the correct operation methods;
2) Only qualified professionals or trained personnel are allowed to install, operate, and maintain the equipment;
3) Personnel operating the equipment, including operators, trained personnel and professionals, must have special operation qualifications required by the local country, such as high-pressure operation, high-altitude operation, special equipment operation qualifications and, etc;
4) Replacement of equipment or components(including software) must be operated by professional or authorized personnel.

2.5 Electrical Safety

1) Before electrical connections, please make sure thatthe equipmentis not damaged, otherwise it may cause electric shock or fire;
2) Do notinstall or remove any power cord when power up. Arcing or sparks may be generated when the power cord is in contact with a conductor, which may

cause fire or personal injury;

3) All electrical connections must comply with the national electrical standards where the projectis located;
4) The cables provided by the user shall comply with the local laws and regulations;
5) Special insulation tools shall be used for high-voltage operation;
6) Make sure thatthe identification on the power cord is correct before connecting the power cord;
7) The equipment can only be operated after 5 minutes when the device is completely powered off;
8) When the cables are used in a high temperature environment, the insulation layer ofthe cable may be aged or damaged. Therefore, the distance between the cable and the heat source must be at least 30mm;
9) Cables ofthe same type shall be tied together, and the wiring time distance of differenttypes of cables shall be at lea st 30mm, without winding or crossing.

2.5.1 Earthing Requirements

1) When installing equipmentthat needs to be grounded, the protective ground wire must be installed first; when dismantling the equipment, the protective grounding wire must be removed last;
2) Do not destroy the grounding conductor;
3) Itis forbidden to operate the equipment withoutinstalling the grounding conductor;
4) The equipment should be permanently connected to ground wire. Before operating the equipment, check the electrical connection ofthe equipmentto ensure thatthe equipmentis reliably grounded.

2.5.2 Installation Environment Requirements

1) This productis only for indoor use, itis strictly prohibited to use in the outdoor environment;
2) Do notinstall or use this productin temperatures below -10 ℃ or above 50℃;
3) Should be installed in a dry, well-ventilated environmentto ensure good heat dissipation performance;
4) The product can be installed at an altitude of 2000m above sea level;

5) The installation position should be far away from the fire source;
6) Keep away from children and animals during installation and use;
7) The installation position should be far away from the faucet, sewer, nozzle and other water sources, to avoid water intake;
8) The equipment shall be placed on a firm and flat supporting surface;
9) Do not place any inflammable and explosive items around the equipment;
10) Do not block the vent and heat dissipation system to preventfire caused by high temperature when the equipmentis running.

2.5.3 Installation Notes

Before installation, please read this manual carefully and be familiar with the installation steps.

1) Avoid putting metal objects near the battery to prevent short circuit;
2) Acid gas may be generated while charging, so ensure thatthe environmentis well ventilated;
3) When installing the cabinet, be sure to leave enough space around the equipmentfor heat dissipation; do notinstall the equipment and lead-acid liquid battery in the same cabinetto avoid corrosion ofthe equipment by the acid gas generated when the battery is working;
4) Only charge the type ofbattery that matches this equipment;
5) The weak connection point and the corroded wire may cause great heatto melt the wire insulation layer, burn the surrounding materials, and even cause fire, so to ensure thatthe connector is tightened, the wire is bestfixed with a tie belt, to avoid the wire shaking and loose connector during the mobile application;
6) The system connection cable is selected according to a current density of no more than 5A/mm2;
7) Avoid direct sunlight and rain infiltration during outdoor installation;
8) After the switch ofthe power supply is turned off, there is still high voltage inside the equipment. Do not open or touch the internal devices, and carry out the relevant operation after the capacitor is discharged;
9) Do notinstall the equipmentin damp, greasy, flammable, explosive, large amount of dust and any other severe environment;
10) The polarity ofthe battery inputterminal ofthis productis forbidden to be reversed. Otherwise, itis easy to damage the equipment or cause unpredictable

dangers;

11) Mains input and AC output are high voltage, please do nottouch the wiring point;
12) Do nottouch the fan while working to preventinjury;
13) For the input power ofthe load equipment, it must be confirmed thatthis equipmentis the only input device, and itis forbidden to use itin parallel with other input AC power sources to avoid damage.

2.6 Warning Label

Symbol	Description
	Trash bin forbidden
	Recyclable
	EU Regional Certification
	Electric shock hazard
	Explosive gas
	Alternating current
	Dangerous weight
	Away from babies
	Ensure good connection
	No open flames
	Follow the manual

3. Product Introduction


3.1 Product Overview and Features

ES-LV-16 PLUS is a new generation ofhousehold energy storage system, which has the characteristics of small footprint and simple appearance, and can meetthe more diversified needs of global users. ES-LV-16 PLUS adopts block design, including separation of power module and inverter module, to meet more installation requirements.


The energy storage module adopts high performance and long life lithium iron phosphate battery. Meanwhile, each module consists of 16 314Ah cells connected in series into a 51.2v voltage battery module. Each energy storage module is integrated with a BMS system, used for real-time monitoring and protection of each cell.

3.2 Appearance Description

The ES-LV-16 PLUS consists ofbattery module(including cell and shell parts), battery management system (BMS), communication terminal. Product appearance is shown in the figure below:

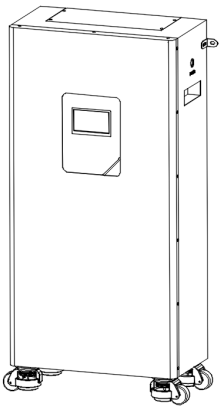

3.2.1 Appearance Introduction

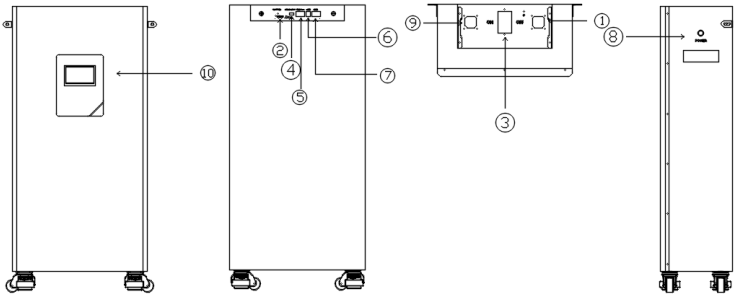

NO.	Explain
①	Battery Positive
②	LED(RUN/ALARM)
③	Air switch
④	Dry Contact
⑤	RS485/CAN
⑥	RS232
⑦	RS485/RS485
⑧	Battery ON/OFF
⑨	Battery Negative
⑩	Display Screen

3.2.2 Port Function Description

Port	Function
Communication Interface	PCS RS485/CAN Communication
	LINK-IN RS485 Communication
	LINK-OUT RS485 Communication
Safety Vents	Balance the Air Pressure and Adjustthe Temperature
Negative Terminal	PACK B- Representative ofthe PACK B-
Earth Terminal	Terminal Ground
Positive Terminal	PACK B+ Representative ofthe PACK B+
Lamp Panel	SOC and Status Display
Power Button	Start Stop

3.3 Working Principle and Function

ES-LV-16 PLUS is an energy storage unit composed of electrochemical batteries, switch buttons, battery management unit, power supply and signal terminals, and mechanical components. Compared with other batteries, it has better charge and discharge performance, more accurate state monitoring, longer cycle life, and less self-discharge loss. With 2-32 packs in parallel to increase the capacity and power ofthe battery system; The entire battery system communicates with the Power Conversion System (PCS) via the RS485 or CAN.

4. Installation Matters

4.1 Check before Installation

Packing Inspection: Before opening the packaging ofthe energy storage, inspectthe outer packaging for any visible damage, such as holes, cracks, or other signs of possible internal damage, and check the type of energy storage. Ifthere is any abnormality in the packaging or the energy storage model is inconsistent, please do not open it and contact us as soon as possible.

Inspectthe deliverables: After opening the outer packaging ofthe energy storage, check whether the delivery is complete and whether there is any obvious external damage. If any items are missing or damaged, please contact us.

4.2 Tool and Labor Insurance

Type	Tool/Labor Security		
Installation Tool			

Personal Wear			


4.3 Selection of Installation Location

4.3.1 Basic Requirements

1) When the energy storage runs, the temperature ofthe cabinet and the radiator will be very high. Therefore, please do notinstall it where itis easy to touch;
2) Do notinstall near the place where flammable and explosive materials are stored;
3) If an energy storage device is installed in a salty area, it will be corroded and may cause a fire. Therefore, do notinstall itin outdoor areas with salt damage. Salt damage area is defined as the area below 500m from the coast or affected by sea breeze. The area affected by sea breeze varies depending on meteorological conditions(such as typhoon, monsoon) or topographical conditions(dam, hill).
4) Do notinstall where accessible to children;
5) Goggles and protective gloves shall be worn when drilling in walls or ground;
6) When drilling, the equipment should be shielded to prevent debris from falling into the equipment. After the drilling process, the debris should be cleaned up in time;
7) When carrying heavy objects, you should be prepared to bear the heavy objects so as notto be crushed or sprained;
8) When operating the equipment by hand, wear protective gloves to avoid injury.


4.3.2 Requirements for the Installation Space

When installing the energy storage equipment, some space should be left around itto ensure thatthere is enough space for installation and heat dissipation.

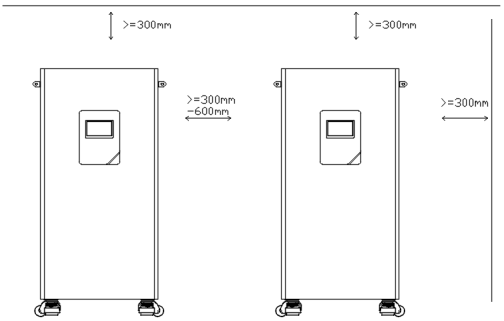

4.4 Equipment Installation

Place the device directly on a flat surface

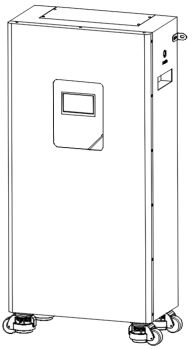

5. Electrical Connection


Before electrical connection, ensure thatthe switches ofthe energy storage and the power module and all switches connected to the energy storage are in "OFF" state and the power module is in "OFF" state. Otherwise, the equipment voltage may

be too high.

1) Equipment damage caused by wiring error is not within the scope ofthe equipment warranty;
2) The operations related to the electrical connection must be carried out by the professional electrical technicians;
3) When making an electrical connection, the operator must wear protective equipment.

Before connecting the battery module, ensure thatthe battery is not active and the battery indicator OFF. Use the power cord shipped with the productto connect the positive and negative electrodes ofthe other battery or power module. It should be noted thatthe red cable is connected to the red terminal (positive terminal), and the black cable is connected to the black terminal (negative terminal).

The signal wires shipped with the product are used for connecting the RS485 interface for each battery module, The communication port ofthe inverter requires a connection to the RS485 or CAN interface. The PV line should be distinguished between into +/- poles, and correctly distinguish between L/N and grounding when connecting AC input wires and AC output wires to avoid short circuit (reference to inverter instruction manual for inverter wiring).

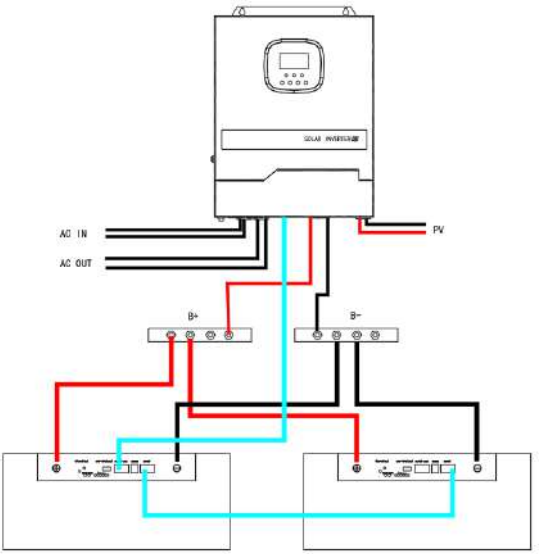

5.1 Battery Module Address Setting

when multiple energy storage battery modules are used in parallel, the product automatically allocates the host and slave address.

5.2 LED Indication Function.

The current power consumption and operation status ofthe product are shown through LED indicator Light Working status indication.

<table>
<tr><td rowspan="2">Status</td><td rowspan="2">Normal / warning/ protection</td><td>ON/ OFF</td><td>RUN</td><td>ALM</td><td colspan="6">Battery capacity LED</td><td rowspan="2">Specification</td></tr>
<tr><td>●</td><td>●</td><td>●</td><td>●</td><td>●</td><td>●</td><td>●</td><td>●</td><td>●</td></tr>
<tr><td>Power off</td><td>Dormancy</td><td>NO</td><td>NO</td><td>NO</td><td>NO</td><td>NO</td><td>NO</td><td>NO</td><td>NO</td><td>NO</td><td>All NO</td></tr>
<tr><td rowspan="2">Ready mode</td><td>Normal</td><td>YES</td><td>Flash1</td><td>NO</td><td colspan="6" rowspan="2">Indicate according to the battery capacity</td><td>Ready mode status</td></tr>
<tr><td>Warning</td><td>YES</td><td>Flash1</td><td>Flash3</td><td>Module low voltage</td></tr>
<tr><td rowspan="3">Charging</td><td>Normal</td><td>YES</td><td>YES</td><td>NO</td><td colspan="6" rowspan="2">Indicate according to the battery capacity(LED 2 flash when it indicate the highest battery capacity)</td><td rowspan="2">LED 2 flash when it is highest battery capacity, ALM do not flash when over-charging</td></tr>
<tr><td>Warning</td><td>YES</td><td>YES</td><td>Flash3</td></tr>
<tr><td>Over charging protection</td><td>YES</td><td>YES</td><td>NO</td><td>YES</td><td>YES</td><td>YES</td><td>YES</td><td>YES</td><td>YES</td><td>If there is no mains power, the indicator turns to standby</td></tr>
</table>

	Temperature over current, failure protection	YES	NO	YES	NO	NO	NO	NO	NO	NO	Stop charging
Discharging	Normal	YES	Flash3	NO	Indicate according to the battery capacity						
	Warning	YES	Flash3	Flash3							
	Under voltage protection	YES	NO	NO	NO	NO	NO	NO	NO	NO	Stop discharging
	Over temperature, current,short circuit, reverse connection, failure protection	YES	NO	YES	NO	NO	NO	NO	NO	NO	Stop discharging
Invalidation		NO	NO	YES	NO	NO	NO	NO	NO	NO	Stop charging and discharging

5.2.1 Capacity Indicator

Status		**Charging**						**Discharging**					
Capacity dictator		L6 ●	L5 ●	L4 ●	L3 ●	L2 ●	L1 ●	L6 ●	L5 ●	L4 ●	L3 ●	L2 ●	L1 ●
Battery level(%)	0~ 16.6%	NO	NO	NO	NO	NO	Flash 2	NO	NO	NO	NO	NO	YES
	16.6~33.2%	NO	NO	NO	NO	Flash2	YES	NO	NO	NO	NO	YES	YES
	33.2~49.8%	NO	NO	NO	Flash2	YES	YES	NO	NO	NO	YES	YES	YES
	49.8~66.4%	NO	NO	Flash2	YES	YES	YES	NO	NO	YES	YES	YES	YES

	66.4~83.0%	NO	Flash2	YES	YES	YES	YES	NO	YES	YES	YES	YES	YES
	83.0~ 100%	Flash2	YES	YES	YES	YES	YES	YES	YES	YES	YES	YES	YES
Working dictator●		YES						Flash 3					

5.2.2 LED Flashing Instructions

Flash Way	Bright	NO
Flash 1	0.25S	3.75S
Flash 2	0.5S	0.5S
Flash 3	0.5S	1.5S

Note:The LED indicator alarm can be enabled or disabled through the host computer. The factory defaultis enabled.

5.3 Communication Function

5.3.1 RS485 Communication

The BMS has the RS485 upper computer communication and cascade communication function ofthe battery pack, and the default value ofthe baud rate is 9600bps. The communication interface of RS485 is defined as shown in the table below.

RS485, Interface-8P8C vertical RJ 45 socket

PIN	Definition	Port	Top view
1、8	RS485 B1	Independent RS485 interface 1	
2、7	RS485 A1		
3、6	Ground		
4、5	NC(dangling)		

PIN	Definition	Port	Top view


1、8	RS485 B2	Independent RS485 interface 2A	
2、7	RS485 A2		
3、6	Ground		
4、5	NC(dangling)		

PIN	Definition	Port	Top view
1、8	RS485 B2	Independent RS485 interface 2B	
2、7	RS485 A2		
3、6	Ground		
4、5	NC(dangling)		

CAN communication (with CAN communication interface, optional)

PIN	Definition	Port	Top view
4	CANH	CAN communication interface	
5	CANL		
2	GND		
1、3、6、7、8	NC		

RS232 communication (with RS232 communication interface)

PIN	Definition	Port	Top view
3	RX	RS232 communication interface	
4	TX		
5	GND		
1、2、6	NC		

5.4 Battery Status Mode

Sleep Mode: Without RS485/CAN communication, charging/discharging or pressing any buttons, this power box will enter into sleep mode to save the power 24h later, it has small self-consumption;

Awake mode: When the system is in sleep mode, if any ofthe following requirements, the system will quitthe sleep mode and enter into the normal

operation mode.

1) Automatic wake-up after charged with voltage higher than 51.2V;
2) Press the key button for 3~6 seconds, release the key button and activate it;
3) Access communication line (RS232), activate it with upper computer software.

Power-off mode wake-up:

1) Charging voltage should be greater than 58V.
2) Press the button for 3~6 seconds and release the button.

6. Electrical Specification and BMS

6.1 Electrical Specification


Unless there is special requirement, the test shall be done under temperature of 25±2℃ and with relative humidity of 45~85%.

<table>
<tr><th>Items</th><th colspan="5">Test Condition</th><th>Standard</th></tr>
<tr><td>Standard Charge</td><td colspan="5">The standard charge means charge the battery in temperature below 25±3℃ with initial charge current of 62.8A(314Ah) and with constant voltage of 58.4V, then charge with constant voltage of 58.4V and with floating currenttaper to 0.5A (314Ah) cut-off (Charger should be exclusively designed for lithium battery, with an accuracy of ±0.05V) within 6 hours.</td><td>/</td></tr>
<tr><td>Standard Discharge</td><td colspan="5">After battery is charged fully in accordance with the standard and then discharge to voltage 40V with discharge current of 62.8A(314Ah).The minimum gap time between charge and discharge period is 30 minutes.</td><td>Minimum Capacity ≥ 314Ah</td></tr>
<tr><td>Cycle Life</td><td colspan="5">After the completion of standard charge and 30 minutes' rest, discharge with 80% DOD with constant current of 0.2C in the (25±3℃) environment, after 6000 cycles, restitfor 1 day and test the capacity in accordance with the above 3.2.</td><td>Capacity≥ 80% Minimum Capacity</td></tr>
<tr><td rowspan="2"></td><td>Discharge current</td><td colspan="4">Discharge Temperature</td><td rowspan="2">At -10℃: Discharge Capacity≥70% At 0℃:</td></tr>
<tr><td>0.2C</td><td>-10℃</td><td>0℃</td><td>25℃</td><td>40℃</td></tr>
</table>

Discharge Character	Batteries shall be charged according to 3.1 and discharged in accordance with the above mentioned temperature. The discharge capacity shall meetthe standard. Batteries shall be stored for 6~8 hours atthe testtemperature.	Discharge capacity≥ 80% At 25℃: Discharge capacity≥ 100% At 40℃: Discharge capacity≥ 100%

6.2 BMS

6.2.1 BMS System Schematic Diagram

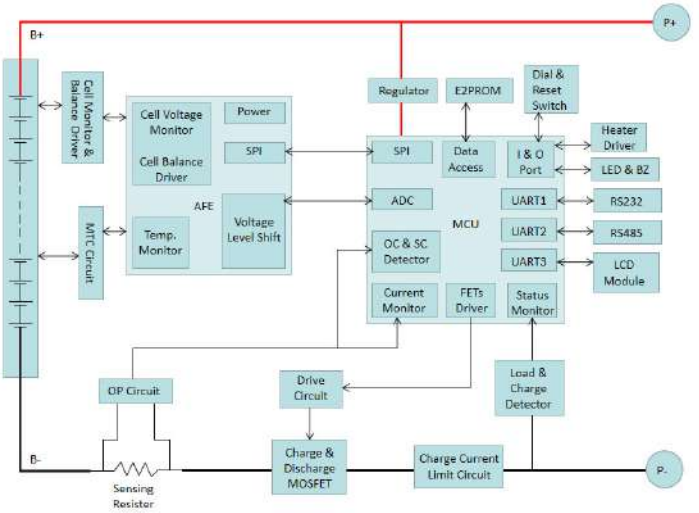

6.2.2 BMS Parameter

NO.	Item		51.2V 314Ah
1	Power Consumption	Low power consumption mode	≤ 200μA

2	Over Charge Protection	Over charge detection voltage	3.65V
		Over charge release voltage	3.40V
3	Over Discharge Protection	Over discharge detection voltage	2.5V
		Over discharge release voltage	2.75V
4	Over Current Protection	Discharging over current detection current (detection time)	210A (1S)
		Discharging over current detection current 1 (detection time)	210A (1S)
		Discharging over current detection current 2 (detection time)	≥ 250A 100ms
5	Temp. Protection	Detection temperature	65±2℃
6	Balance	Balance voltage	3.4V

6.2.3 BMS LED display screen

1. Function introduction


Matching energy storage BMS motherboard, which can display sampling information and working status ofbattery pack through LED screen.

2. Interface Introduction

Interface Introduction




Main status page

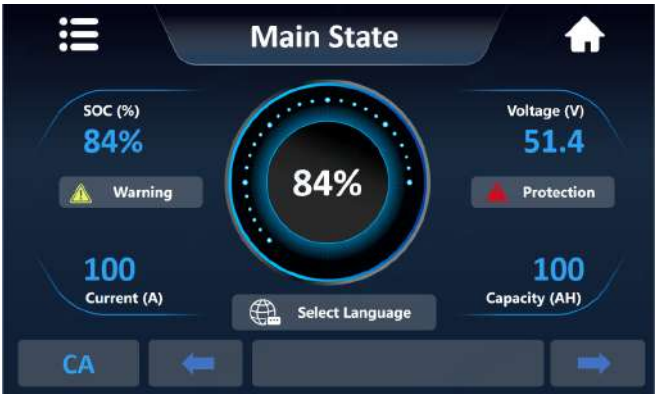


Menu page



Battery cell page

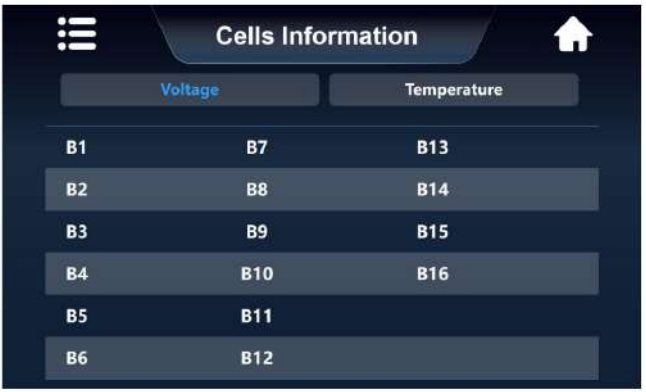

Temperature page

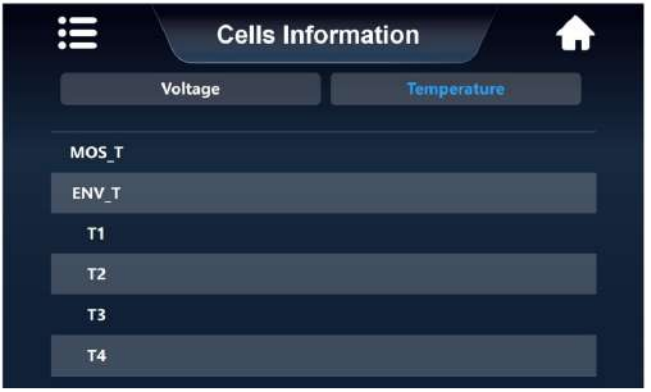

Communication Protocol Selection Page





Built-in unlock password: 82993060

System Settings Page



Menu structure:

- Welcome interface
- min state page
  - SOC(Total)
  - Current
  - Voltage
  - Warranty
  - Protection
  - Parallel operation selection
  - Language Selection

- HOME
  - PACK Info
    - Voltage
      - Cell01 voltage
      - Cell02 voltage
        .....
      - Cell16 voltage
    - Temperature
      - NT1
      - NT2
      - NT3
      - NT4
      - Mos_T
      - ENV_T
        .....
  - BMS Status
  - System(Warning/Protect/Fault)
  - PROTOCOL
    - CAN
      - GOOD WE PROTOCOL
      - LV BMS Protocol(CAN) for Solar Inverter Family EN_V 1.5
      - PYLON PROTOCOL 2.0
      - Pylon CAN bus protocol V 2.0.420211122
      - SMA PROTOCOL
      - SMAF SS-Connecting Bat-TI-en-20W
      - GROW ATT_PROTOCOL
      - Growatt BMS CAN-Bus-protocol-low-voltage
    - RS485
      - USER_485_VOLTRON
      - Voltronic Inverter and BMS 485 communication protocol 20200325(1)
      - PYLON
      - RS 485-protocol-pylon-low-voltag
      - Luxpowertek Battery Protocol RS 485_V 01
  - SYSTEM
    - Language select
    - System No.
      - ★ LCD version
      - ★ BMS version
      - ★ PACK SN
      - ★ BLUETOOTH SN

Note: The protocol listis read from the BMS motherboard, the following is a case, based on the built-in list of each BMS motherboard, change the protocol, the firsttime you need Enter the permission password, the initial password is 82993060, exitthe protocol interface, the permission takes effect, modify the protocol again, you need to verify the permission again.
Administrator password: 82993060, Operator password: 87654321

7. Equipment Acceptance

7.1 Acceptance Standard

NO.	Acceptance items	Acceptance Standard	Inspect
1	The energy storage battery is installed in place	The installation is correct, stable and safe.	
2	The installation environment meets the requirements	The installation space is reasonable, and the environment is clean and tidy.	
3	Battery power cord is connected correctly	The positive and negative poles are correctly connected with no omission.	
4	Battery signal wire is connected correctly	The signal wires are correctly connected and reliable.	
5	Reliable grounding	The ground wire is properly and firmly.	
6	All air switches ofthe	All the air switches are in the	

	power module are turned off	“OFF " state.	
7	All battery module switches are turned off	The start switch is in the “OFF” state	

8. Routine Maintenance and Storage of Batteries

8.1 Battery System Maintenance

After the system is powered off, the shell still has residual power and heat, which may cause electric shock or burns. Therefore, protective gloves should be worn before operating the energy storage system for 5 minutes after the system fails. Before maintaining the energy storage system, make sure that all indicators ofthe energy storage system are off.

During the operation ofthe energy storage system, the system cannot be completely powered off only by turning offthe switch ofthe power unit. No maintenance operations can be performed on the energy storage system atthis time.

System power-down operation steps:

①Disconnectthe switch between the power supply unit and the AC output;

②Disconnectthe switch between the power supply unit and the AC input;

③Disconnectthe switch between the power supply unit and the PV unit;

④Close the switch between the power supply unit and the battery pack;

⑤Turn off all energy storage unit switches and press the energy storage key for 3 seconds until all lights are off and the battery is powered on.

8.2 Routine Maintenance

Item	Method	Maintenance Interval
Battery appearance inspection	Check the radiator regularly for shielding and dirt regularly; Check the appearance for damage and deformation; Listen to whether there is any abnormal sound during the operation.	Every six months to a year

Battery operation status check	When the device is running, check whether the parameter settings are set correctly.	Every six months
Battery line connection inspection	Check whether the line connection is disconnected or loose; Check whether the cable is damaged, especially whether the protective sleeve ofthe contact between the cable and the metal surface is cut out; Check that each interface is locked.	Six months after the first commissioning test, and then six months to a year
Battery grounding line check	Check whether the grounding wire is secure.	Six months after the first commissioning test, and then six months to a year

8.3 Battery Storage

1) When stored, batteries should be placed correctly according to the mark on the box; do not reverse or side;
2) When packing stacked battery packs, they should meetthe stacking requirements on the outer packaging.
3) The battery should be carefully handled, strictly prohibit damage to the battery;
4) Requirements for the storage environment:
   f) Ambienttemperature: -10 ℃~ 55℃, recommended storage temperature: 20℃~ 30℃;
   g) Relative humidity: 5%RH-80%RH
   h) Dry, well-ventilated and clean
   i) Keep away from corrosive organic solvents, gases and other substances;
   j) Avoid direct sunlight;
   k) The distance from the heat source should not be less than 2 meters.
5) When stored, it should be disconnected from the outside; ifthere is an indicator light on the battery panel, the indicator light should be off.
6) After the battery is produced and tested, it should be charged to at least 50% SOC before storage; ifthe device is not used for a long time, the battery should be discharged to 45% ~ 60% ofthe battery capacity, and the battery output should be disconnected to avoid battery power exhaustion;

7) Do nottouch the battery pack with your wet hands;

8) Do not squeeze, fall, or puncture the battery;

9) Batteries should always be disposed ofin accordance with local safety regulations;

10) The battery shall be stored and charged as specified in this manual;

11) When storing or transporting the battery, do not reverse the polarity ofthe battery, batteries must not be stacked without protective packaging, and the number of stacked pack batteries shall not exceed the number specified on the package;

12) All operators ofthe energy storage system shall follow the user manual, installation and maintenance manual, and quality assurance requirements; Equipment damage caused by ignoring or misreading user manuals, installation and maintenance manuals, and quality assurance requirements will void the product warranty.

8.4 Battery Module Data

Model	ES-LV-16 PLUS
Nominal Voltage	51.2VDC
Voltage Range	44V-58.4V
Nominal Capacity	314Ah
Rated Capacity	16.08kwh
Communication Protocol	CAN/RS485/RS232
Maximum Number of Parallel Connections	32
Service Life	5-10 years
Calendar Life	8000（@80% DOD)
Nominal Voltage	Temperature protection, over-current protection, short-circuit protection, over-charge protection, over-discharge protection, low-voltage protection
Charging Parameters	
Recommended Charging Current	100A
Maximum Charging Current	200A
Recommended Charging Voltage	58V
Maximum Charging Voltage	58.4V

Discharging Parameters	
Recommended Discharging Current	100A
Maximum Discharging Current	200A
Recommended Battery Discharge Cut-off Voltage	44V
Battery Cut-off Voltage	40 V
Battery Recovery Voltage	48V
Physical Parameters	
Dimension	900*460*245mm
Weight	118.4kg
Shell Material	Sheet metal
Protection Level	IP20
Installation Method	Floor type
Cell Type	LiFePO4
Certification & Safety Standard	
Safety Certificate	CE
Transportation Safety Certification	UN38.3, Class9
Temperature Parameters	
Discharging Temperature	-20-60℃
Charging Temperature	0-55℃
Storage Temperature	-20-45℃

Maintenance Record

Dear user, thank you for selecting our product.

Please fill in and keep the warranty card for better services.

Name:_____

Tel:_____

Address:_____

Brand:_____

Product No:_____

Equipment No:_____

Purchase Date:_____

Agent Name:_____

Maintenance Record			
Date of Repair	Content	Maintenance Personnel	Note